



4701 Northshore Drive
North Little Rock, AR 72118

TEL 501.376.3633
FAX 501.372.8042

www.GarverUSA.com

ADDENDUM NO. 2

Date: May 19, 2025
Project Name: ABP Fire Suppression Improvements
Owner: Little Rock Municipal Airport Commission
Owner Project No.: 231000
Garver Project No. 21A10111

This addendum shall be a part of the Plans, Contract Documents and Specifications to the same extent as though it were originally included therein, and it shall supersede anything contained in the Plans, Contract Documents, and Specifications with which it might conflict. This addendum, including all attachments, shall become part of the Contract and all provisions of the Contract shall apply thereto. The time provided for completion of the Contract has not been changed as noted in this addendum. Acknowledgement of receipt of this addendum must be noted in the appropriate section of the Bid Form and included with the Contract Documents.

A. REQUESTS FOR INFORMATION:

1. Natural Gas Generators are shown as having a load bank on the drawings, is this correct?
 - a. No, load banks are not required to be installed with the units. Updated drawings are attached to clarify.
2. There are two diesel generators called for on the plans, a 150kW unit at B100 and a 750kW unit at B1000 – what tank size should these be? What is the run-time expected to be?
 - a. Standard sub-base day tanks are requested for the diesel generators, with run-time expected to be a minimum of 24 hours.

B. DRAWINGS:

1. Electrical
 - a. Refer to Sheet EP-602 – Electrical One-Line Diagrams – Buildings 200 & 300, dated 5/16/25.
 - i. Remove load bank from generator.
 - b. Refer to Sheet EP-603 – Electrical One-Line Diagrams – Buildings 400 & 500, dated 5/16/25.
 - i. Remove load bank from generator.

By: *Nick Holland*

Nick Holland, P.E.
Project Manager





Attachments:

EP-602 – Electrical One-Line Diagrams – Buildings 200 & 300

EP-603 – Electrical One-Line Diagrams – Buildings 400 & 500

END OF ADDENDUM NO. 2

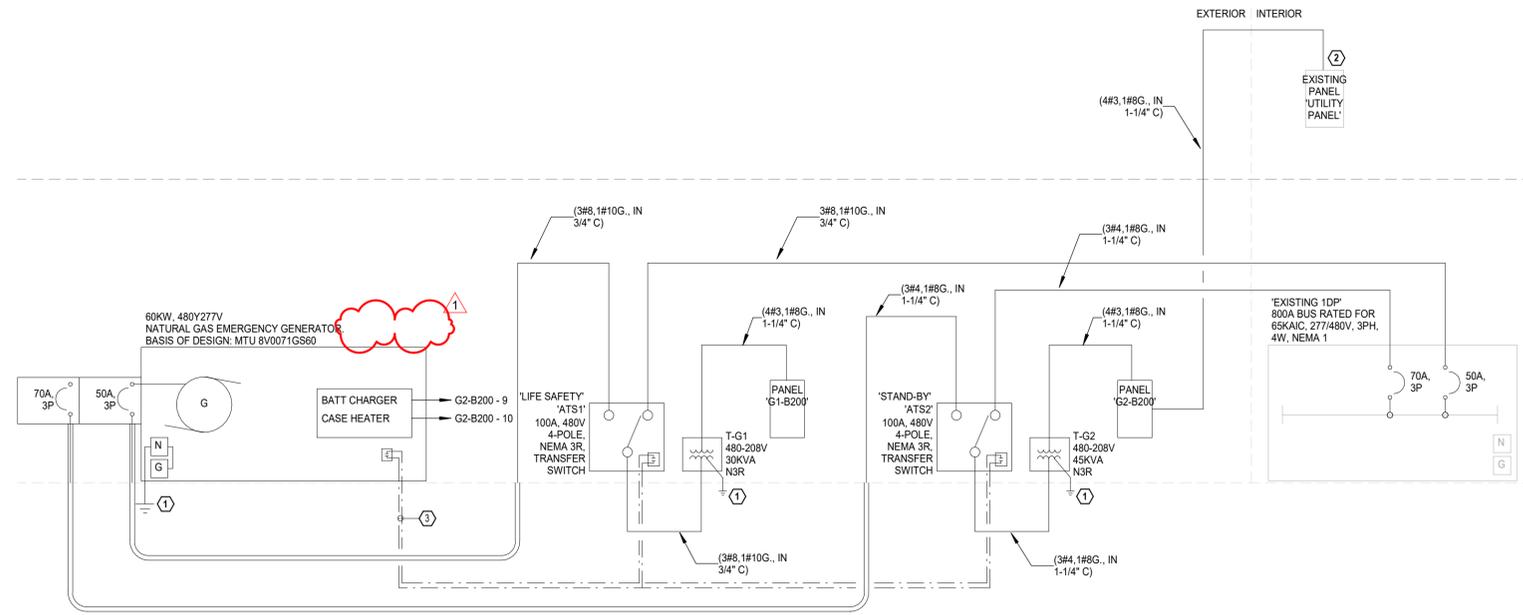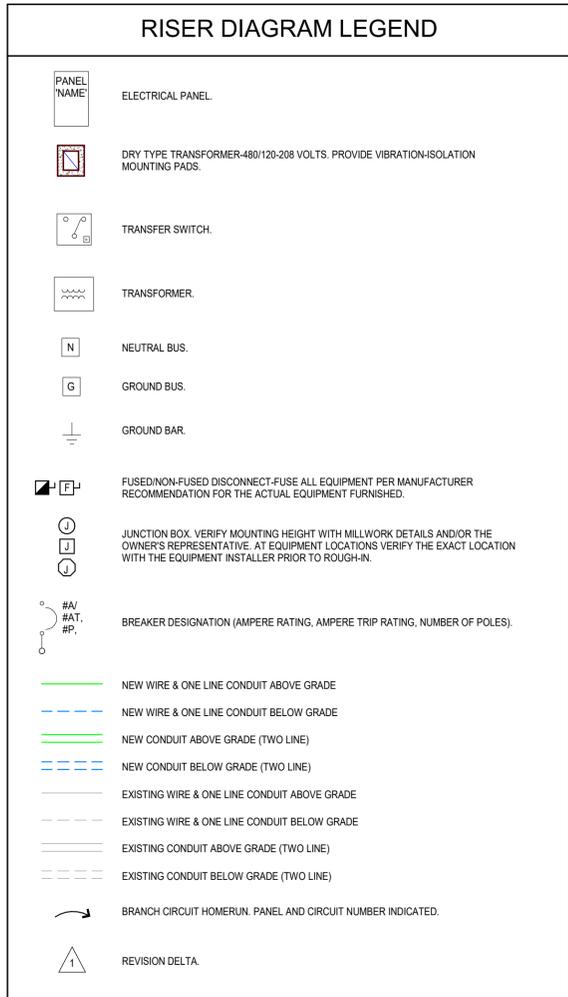

ONE-LINE DIAGRAM GENERAL NOTES:


- A. CONTRACTOR SHALL PROVIDE ENGRAVED NAMEPLATE ON ALL NEW ELECTRICAL EQUIPMENT INDICATING EQUIPMENT VOLTAGE, AMPERAGE AND AVAILABLE SHORT CIRCUIT RATING PER 2017 NEC.
- B. ALL CONDUCTORS SHALL BE COPPER.
- C. PRIOR TO INSTALLATION OF UNDERGROUND FEEDERS, THE ELECTRICAL CONTRACTOR SHALL SUBMIT AN UNDERGROUND ROUTING PLAN TO THE ENGINEER OF RECORD. SUBMITTAL SHALL INDICATE THE EXACT ROUTING PATH FOR ALL UNDERGROUND CONDUIT, STUB-UP LOCATIONS, SIZE AND QUANTITY OF CONDUIT. ALL ELECTRICAL PANELS AND EQUIPMENT SHALL BE SHOWN ON THIS PLAN FOR REFERENCE OF CONDUIT TERMINATION.

ELECTRICAL KEYED NOTES:

- ① PROVIDE GROUNDING PER NEC ARTICLE 250 REQUIREMENTS.
- ② REMOVE UTILITY PANELBOARD FEEDER BACK TO SOURCE DISTRIBUTION PANELBOARD. FIELD TRACE PRIOR TO REMOVAL.
- ③ CONTROL WIRING IN 3/4\"/>

1 ELECTRICAL RISER DIAGRAM - BUILDING 200

NOT TO SCALE

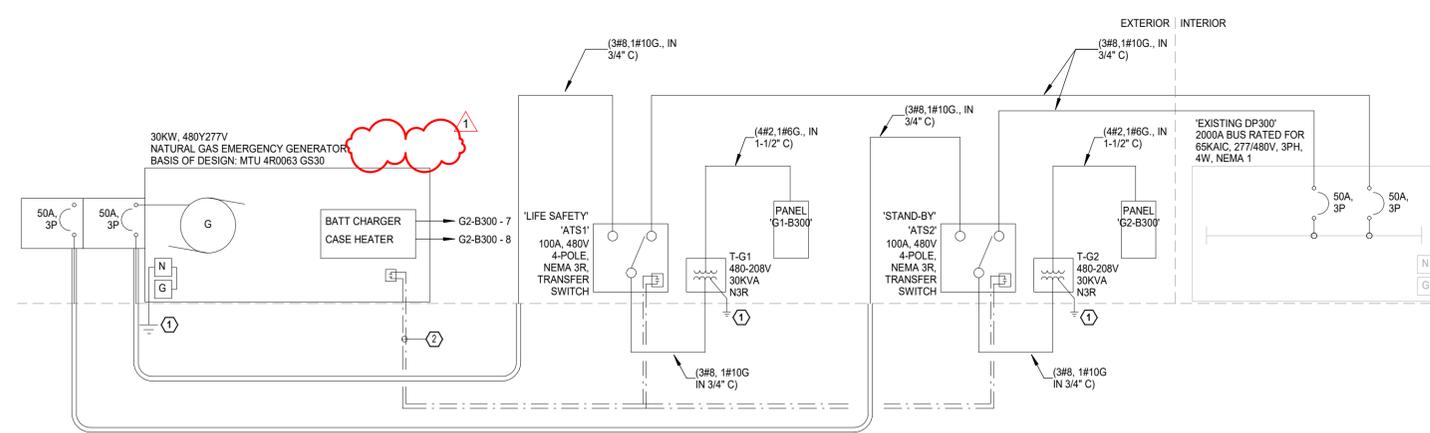

ONE-LINE DIAGRAM GENERAL NOTES:

- A. CONTRACTOR SHALL PROVIDE ENGRAVED NAMEPLATE ON ALL NEW ELECTRICAL EQUIPMENT INDICATING EQUIPMENT VOLTAGE, AMPERAGE AND AVAILABLE SHORT CIRCUIT RATING PER 2017 NEC.
- B. ALL CONDUCTORS SHALL BE COPPER.
- C. PRIOR TO INSTALLATION OF UNDERGROUND FEEDERS, THE ELECTRICAL CONTRACTOR SHALL SUBMIT AN UNDERGROUND ROUTING PLAN TO THE ENGINEER OF RECORD. SUBMITTAL SHALL INDICATE THE EXACT ROUTING PATH FOR ALL UNDERGROUND CONDUIT, STUB-UP LOCATIONS, SIZE AND QUANTITY OF CONDUIT. ALL ELECTRICAL PANELS AND EQUIPMENT SHALL BE SHOWN ON THIS PLAN FOR REFERENCE OF CONDUIT TERMINATION.

ELECTRICAL KEYED NOTES:

- ① PROVIDE GROUNDING PER NEC ARTICLE 250 REQUIREMENTS.
- ② CONTROL WIRING IN 3/4\"/>

2 ELECTRICAL RISER DIAGRAM - BUILDING 300

NOT TO SCALE



© 2025 GARVER, LLC
 THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

REV	DATE	DESCRIPTION
1	5/12/25	ADDENDUM NO. 2

BILL AND HILLARY CLINTON NATIONAL AIRPORT
 LITTLE ROCK, ARKANSAS 72206

FIRE SUPPRESSION IMPROVEMENTS



ELECTRICAL ONE-LINE DIAGRAMS - BUILDINGS 200 & 300

JOB NO.: 21A10111
 DATE: MAY 2, 2025
 DESIGNED BY: JHH
 DRAWN BY: JHH

BAR IS ONE INCH ON ORIGINAL DRAWING
 0 1"
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
EP-602



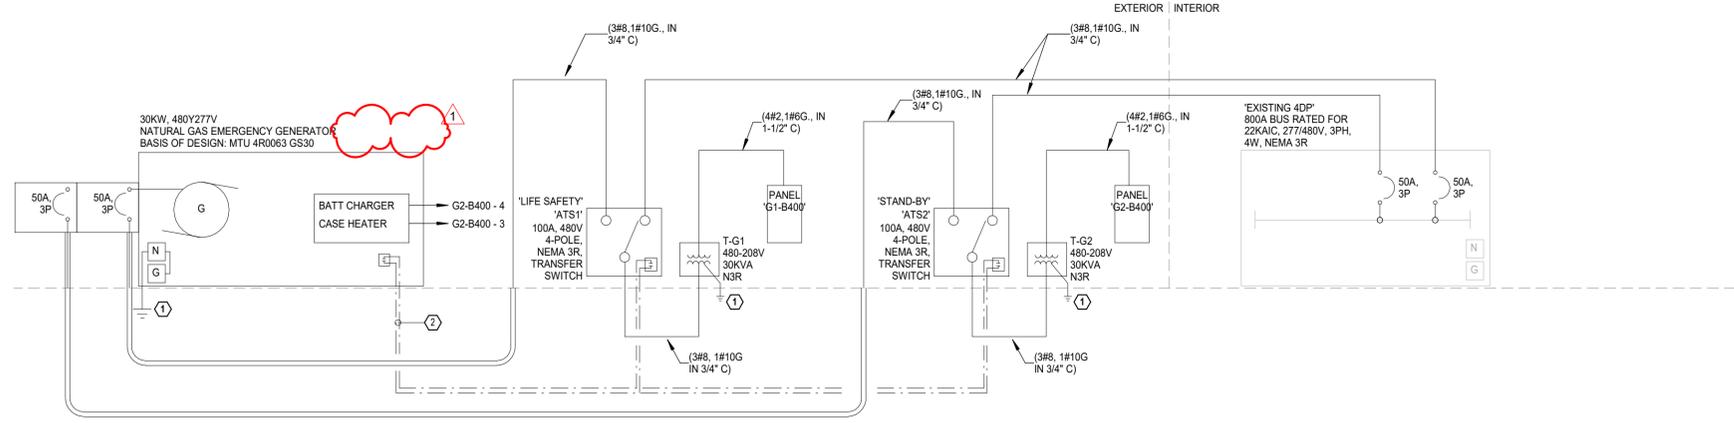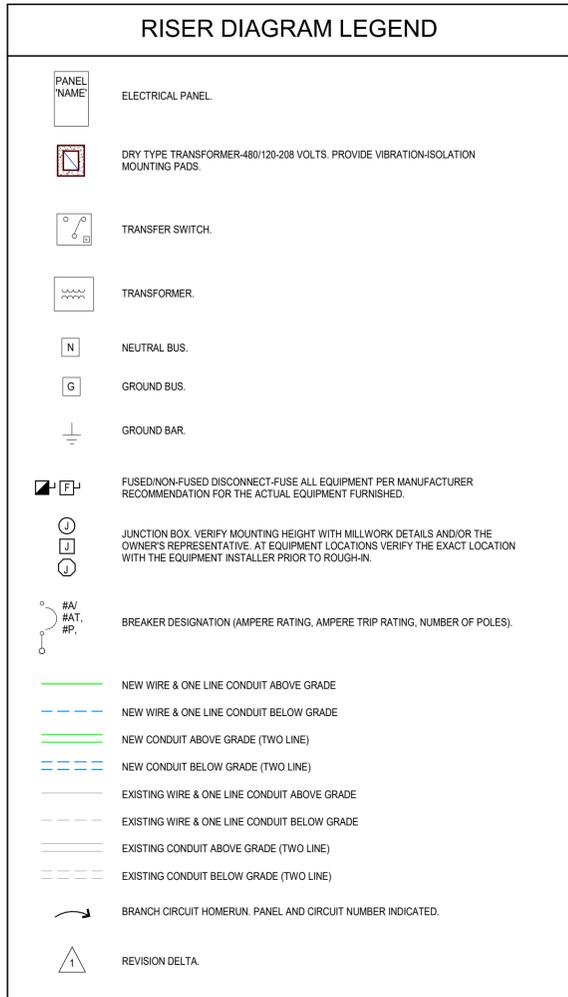


ONE-LINE DIAGRAM GENERAL NOTES:

- A. CONTRACTOR SHALL PROVIDE ENGRAVED NAMEPLATE ON ALL NEW ELECTRICAL EQUIPMENT INDICATING EQUIPMENT VOLTAGE, AMPERAGE AND AVAILABLE SHORT CIRCUIT RATING PER 2017 NEC.
- B. ALL CONDUCTORS SHALL BE COPPER.
- C. PRIOR TO INSTALLATION OF UNDERGROUND FEEDERS, THE ELECTRICAL CONTRACTOR SHALL SUBMIT AN UNDERGROUND ROUTING PLAN TO THE ENGINEER OF RECORD. SUBMITTAL SHALL INDICATE THE EXACT ROUTING PATH FOR ALL UNDERGROUND CONDUIT, STUB-UP LOCATIONS, SIZE AND QUANTITY OF CONDUIT. ALL ELECTRICAL PANELS AND EQUIPMENT SHALL BE SHOWN ON THIS PLAN FOR REFERENCE OF CONDUIT TERMINATION.

ELECTRICAL KEYED NOTES:

- ① PROVIDE GROUNDING PER NEC ARTICLE 250 REQUIREMENTS.
- ② CONTROL WIRING IN 3/4\"/>

1 ELECTRICAL RISER DIAGRAM - BUILDING 400
NOT TO SCALE

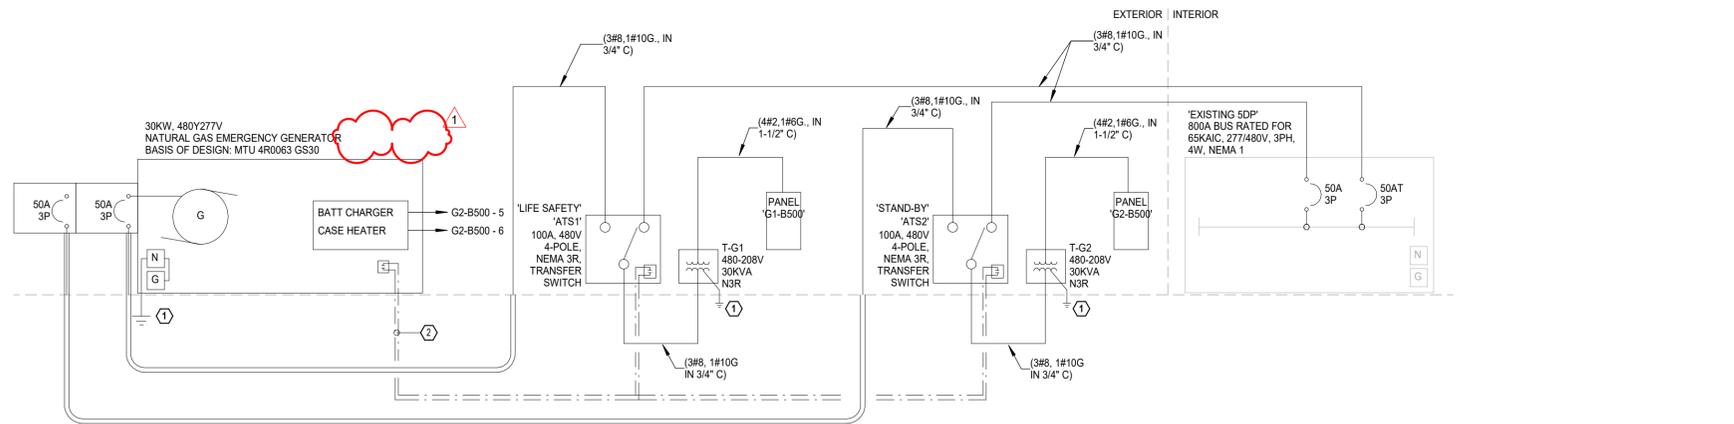

ONE-LINE DIAGRAM GENERAL NOTES:

- A. CONTRACTOR SHALL PROVIDE ENGRAVED NAMEPLATE ON ALL NEW ELECTRICAL EQUIPMENT INDICATING EQUIPMENT VOLTAGE, AMPERAGE AND AVAILABLE SHORT CIRCUIT RATING PER 2017 NEC.
- B. ALL CONDUCTORS SHALL BE COPPER.
- C. PRIOR TO INSTALLATION OF UNDERGROUND FEEDERS, THE ELECTRICAL CONTRACTOR SHALL SUBMIT AN UNDERGROUND ROUTING PLAN TO THE ENGINEER OF RECORD. SUBMITTAL SHALL INDICATE THE EXACT ROUTING PATH FOR ALL UNDERGROUND CONDUIT, STUB-UP LOCATIONS, SIZE AND QUANTITY OF CONDUIT. ALL ELECTRICAL PANELS AND EQUIPMENT SHALL BE SHOWN ON THIS PLAN FOR REFERENCE OF CONDUIT TERMINATION.

ELECTRICAL KEYED NOTES:

- ① PROVIDE GROUNDING PER NEC ARTICLE 250 REQUIREMENTS AND ELECTRICAL DETAILS.
- ② CONTROL WIRING IN 3/4\"/>

2 ELECTRICAL RISER DIAGRAM - BUILDING 500
NOT TO SCALE



© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

REV	DATE	DESCRIPTION
1	5/12/25	ADDENDUM NO. 2

BILL AND HILLARY CLINTON NATIONAL AIRPORT
LITTLE ROCK, ARKANSAS 72206

FIRE SUPPRESSION IMPROVEMENTS

ELECTRICAL ONE-LINE DIAGRAMS - BUILDINGS 400 & 500

JOB NO.: 21A10111
DATE: MAY 2, 2025
DESIGNED BY: JHH
DRAWN BY: JHH

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER EP-603

